



DETALIU RACORDARE HIDRANT SUBTERAN

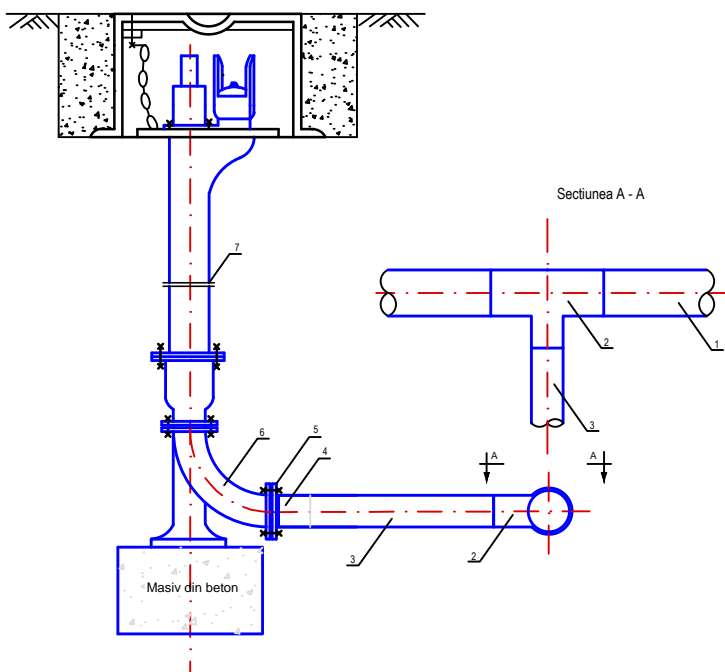

7	Hidrant de incendiu subteran, PN6, DN 80 mm, inclusiv cutia	1	FONTA	Dn = 80mm
6	Cot cu picior si flanse din fonta, PN6, DN 80 mm	1	FONTA	Dn = 80mm
5	Flansa metalica DN 80mm	1	OTEL	Dn = 80mm
4	Adaptor flansa PE-ID, PE 100, PN 6, De 90x3,3 mm, SDR 27,6	1	PE-ID SDR 27,6 PN6	De = 90mm
3	Conducta din PE-ID, PE 100, PN6, De 90x3,3 mm SDR 27,6	1	PE-ID SDR 27,6 PN6	De = 90mm
2	Teu redus din PE-ID, PE 100, PN6, De 110x90mm SDR 27,6	1	PE-ID SDR 27,6 PN6	De=110/90mm
1	Conducta din PE-ID, PE 110, PN 6 De 110x4,0 mm SDR 27,6	1	PE-ID SDR 27,6 PN6	De = 110mm
Poz	Denumire	Bucati	Calitate	Dimensiuni
			Material	

VERIFICATOR EXPERT	NUME	UGO P	VWTC	CERIP C	REFERAT/EXPERTIZA/NR.DATA
 102/1925/2004, Arad UNITE de ing. si proiect. de 53.3a 04 Tel.0357 408313, 0257 338002 e-mail.office@arcoinstal.ro; arcoinstal@yahoo.com					Beneficiar: COMUNA VLADIMIRESCU
					Nr.p 489